



Facilities Management
Capital Construction & Renovations

Leake Building | 1450 Leake Drive
P.O. Box 400726, Charlottesville, VA 22904-4726
(434) 982-4621 | Fax (434) 982-4628
www.fm.virginia.edu

Date: September 8, 2025

Alert No. 4

CONSTRUCTION ALERT **Non-UVA Project**

RWSA 36" Raw Water Main

ITEMS OF INTEREST:

Beginning **September 14**, nightly lane closures will take place on **Fontaine Avenue Ext.** between 9:00 PM to 5:00 AM.

Duration: Approximately through **mid-October**

Impact: Affected lanes will close each night and reopen by 5:00 AM the following morning.

Motorists are advised to use caution when traveling through the area and to expect potential delays.

BACKGROUND:



- The Ragged Mountain Reservoir to Observatory Water Treatment Plant Raw Water Line will span approximately 4 miles, between Ragged Mountain Reservoir and Observatory Water Treatment Plant. All piping installed will be 36-inch in diameter, and the Ragged Mountain Raw Water Pump Station will have the capacity to initially transfer up to 10 million gallons per day (MGD) of raw water from Ragged Mountain Reservoir to Observatory Water Treatment Plant



ISSUED BY:

•

Caitlin Murtaugh, Project Manager, Capital Construction and Renovations, cm8nf@virginia.edu, 434.906.3075

PHOTOS/MAPS OF AREAS AFFECTED:

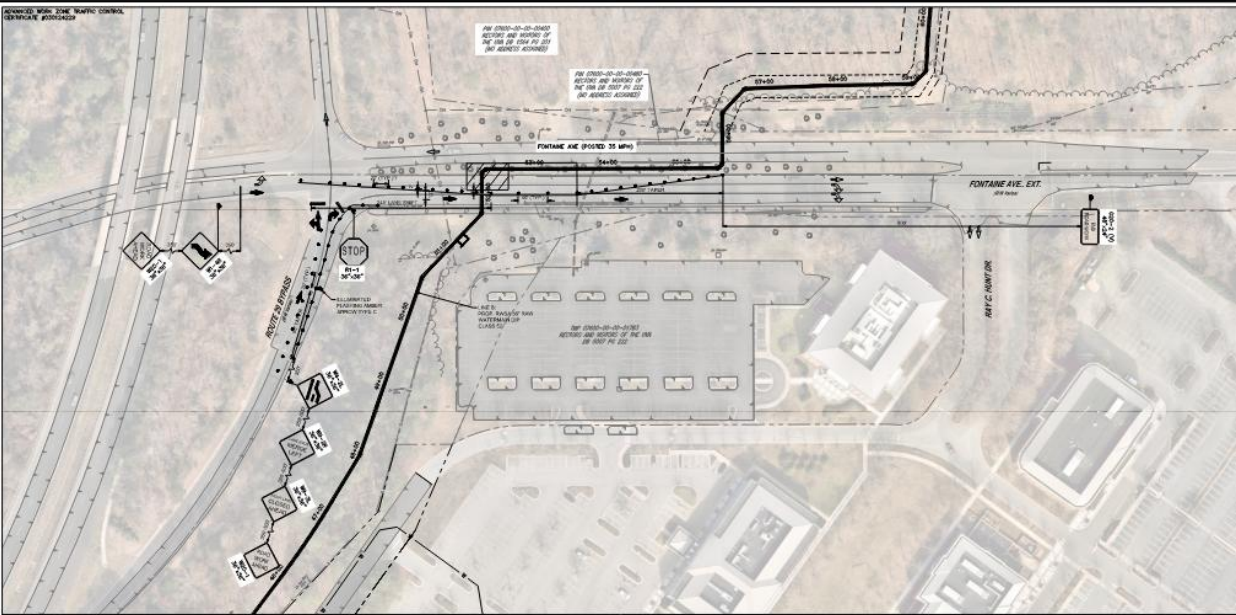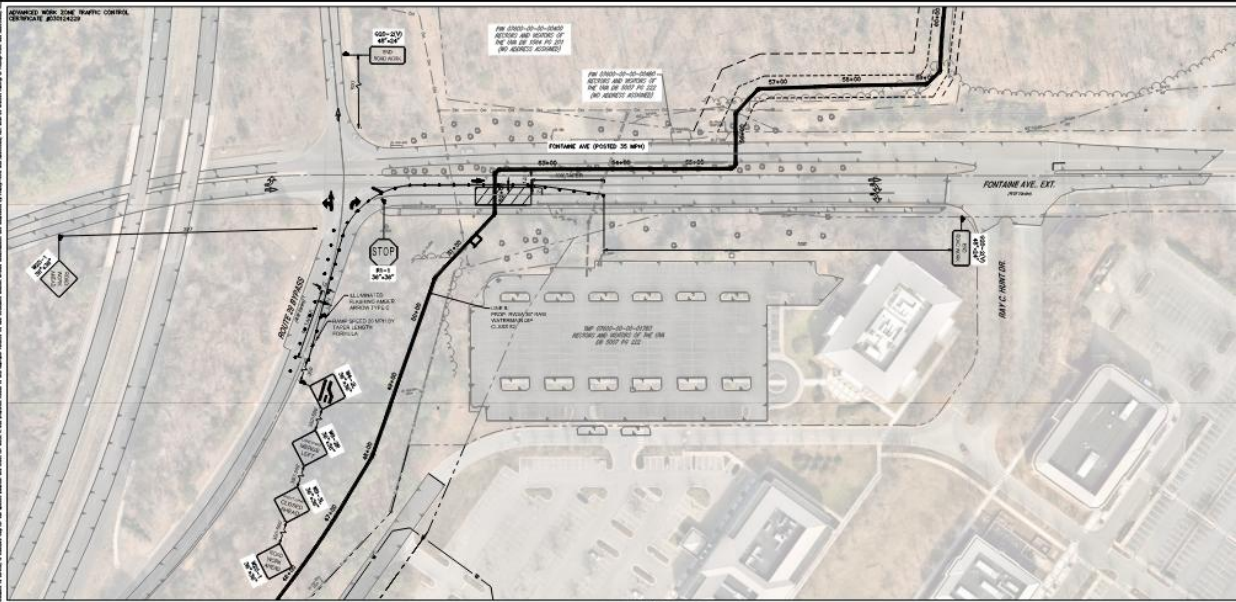

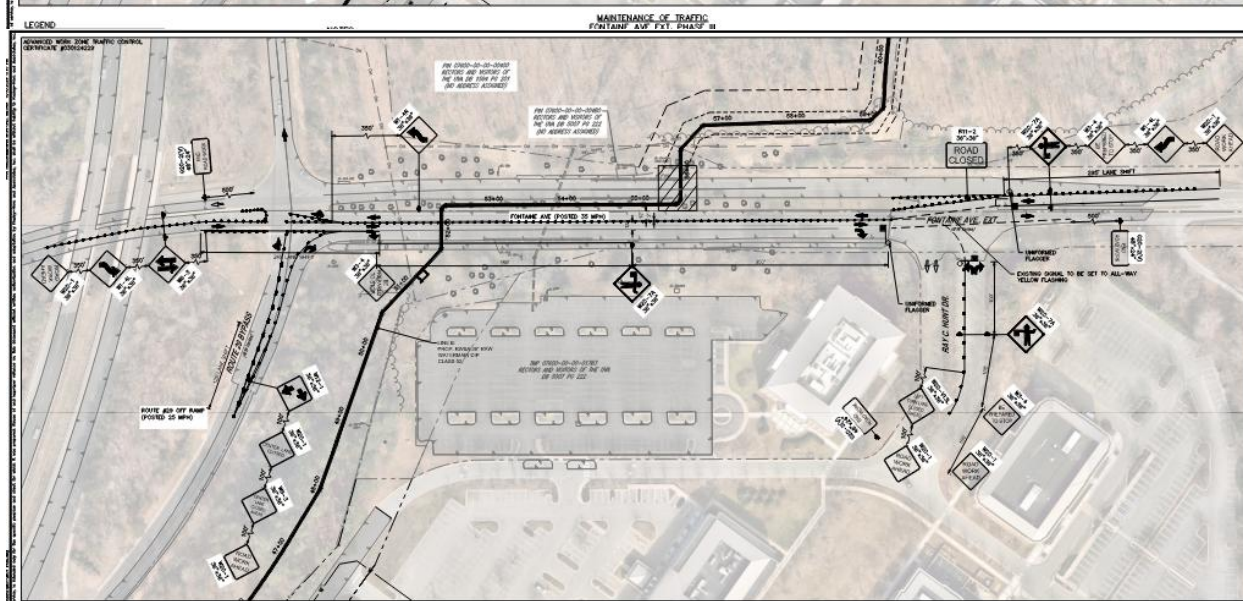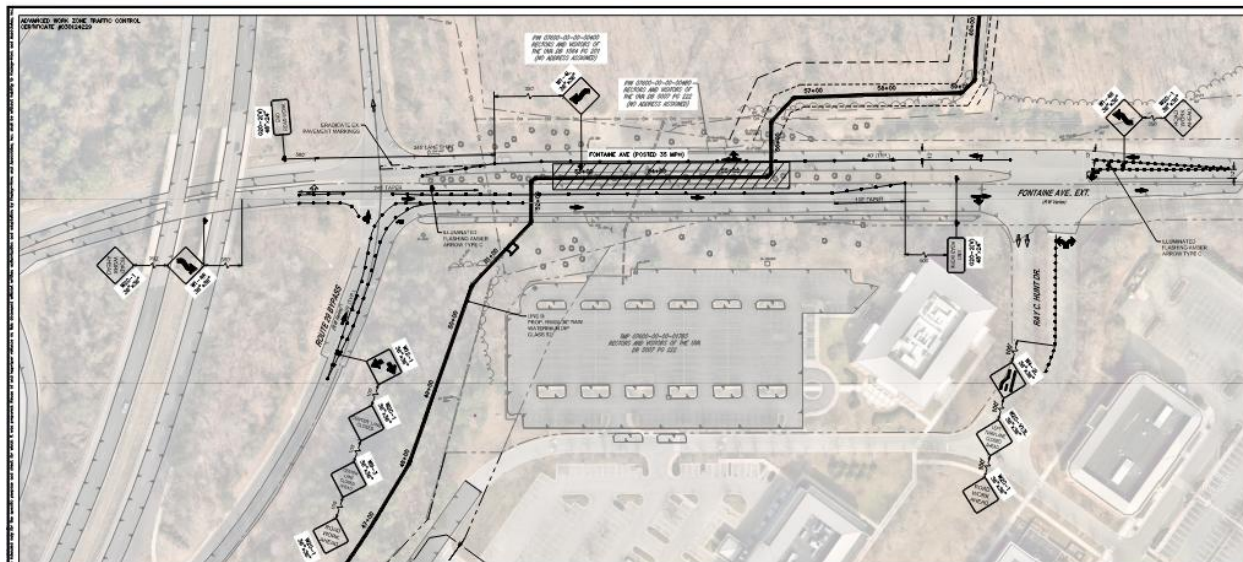

END OF ALERT